



777 Cypress Ave.
Redding CA 96001
(530) 225-4013 – Fax (530) 225-4360

**AFFIDAVIT SELF CERTIFICATION FOR
COMPLIANCE OF SMOKE AND CARBON
MONOXIDE DETECTORS**

Property Address: _____

Permit Number: _____

When the valuation of additions, alterations, or repairs to dwelling units exceeds \$1,000.00, SMOKE DETECTORS shall be installed in each sleeping room, and outside each separate sleeping area in the immediate vicinity of the bedrooms, and on each additional story of the dwelling, including basements and habitable attics as required by Section R314, of the California Residential Code (CRC) and Section 420 and 907 of the California Building Code (CBC) and Section 704 of the International Property Management Code (IPMC).

Regardless of valuation, for dwellings or sleeping units containing fuel burning appliances or having attached garages, CARBON MONOXIDE detectors shall be installed outside each separate sleeping area in the immediate vicinity of the bedrooms, and on each additional story of the dwelling, including basements as required by Section R315 of the CRC and Section 420 of the CBC Multipurpose (combination carbon monoxide and smoke) alarms may be used per Section R315 of the CRC and Section 907 of the CBC.

All alarms shall comply with requirements for listing and approval by the Office of the State Fire Marshal. As owner of the above-referenced property, I hereby certify that I have installed the smoke detectors and carbon monoxide detectors in accordance with the manufacturer’s instructions and in compliance with the above sections of the California Residential Code, California Building Code and California Health and Safety Code.

I declare under penalty of perjury that the foregoing is true and correct, and that this declaration was executed on (Date) _____ at Redding, California.

Owner’s Name (printed/typed): _____


Signature of Owner: _____

The certification must be returned to the City of Redding building inspector prior to final sign-off of all permits requiring compliance.

Note: Form to be used only for permit types where building inspector is not required to go into residential dwelling unit.

Residential Smoke and Carbon Monoxide Alarm Requirements

Effective January 01, 2011, **all** residential permits exceeding \$1000 in valuation will require smoke & carbon monoxide detectors throughout the residence. Smoke & carbon monoxide detectors **must** be installed in accordance with the **2010 California Residential Code (CRC)** and will be verified at the permit final. All alarms shall comply with requirements for listing and approval by the Office of the State Fire Marshal.

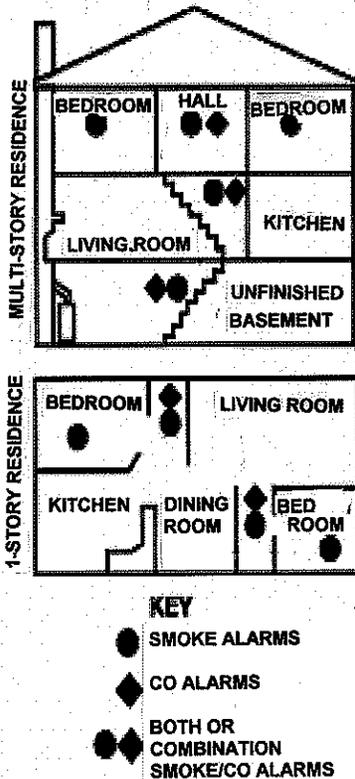

Smoke Alarms shall be installed in the following locations:

- In each sleeping room.
- Outside each sleeping area in the immediate vicinity of the bedrooms.
- On each additional story of the dwelling, including basements but not including crawl spaces and uninhabitable attics

Carbon Monoxide Alarms shall be installed in the following locations:

- Outside of each separate dwelling unit sleeping area in the immediate vicinity of the bedroom(s).
- On every level of a dwelling unit including basements.

Power and Interconnection

- Power must be supplied by the buildings primary power source for both smoke and carbon monoxide detectors and they must have a battery back up.

For existing buildings where walls and ceiling finishes are not being opened a battery only device may be used.

- Where more than one smoke detectors is installed they must be interconnected
- Where more than one Carbon monoxide alarm is installed they must be interconnected
- Interconnection is not required in existing dwelling units where repairs do not result in the removal of wall and ceiling finishes, there is no access by means of attic, basement or crawl space, and no previous method for interconnection existed.

Smoke Alarms (CRC Section R314)

Alterations, repairs, and additions.

When alterations, repairs or additions requiring a permit occur, or when one or more sleeping rooms are added or created in existing dwellings, the individual dwelling unit shall be equipped with smoke alarms located as required for new dwellings.

Carbon Monoxide Alarms (CRC Section R315)

Where required in existing dwellings.

Where a permit is required for alterations, repairs or additions exceeding \$1000, existing dwelling units that have attached garages or fuel burning appliances shall be provided with carbon monoxide alarms.