


TEXT BLACK  
COLOR (TYP.)

BACKGROUND  
YELLOW COLOR  
(TYP.)

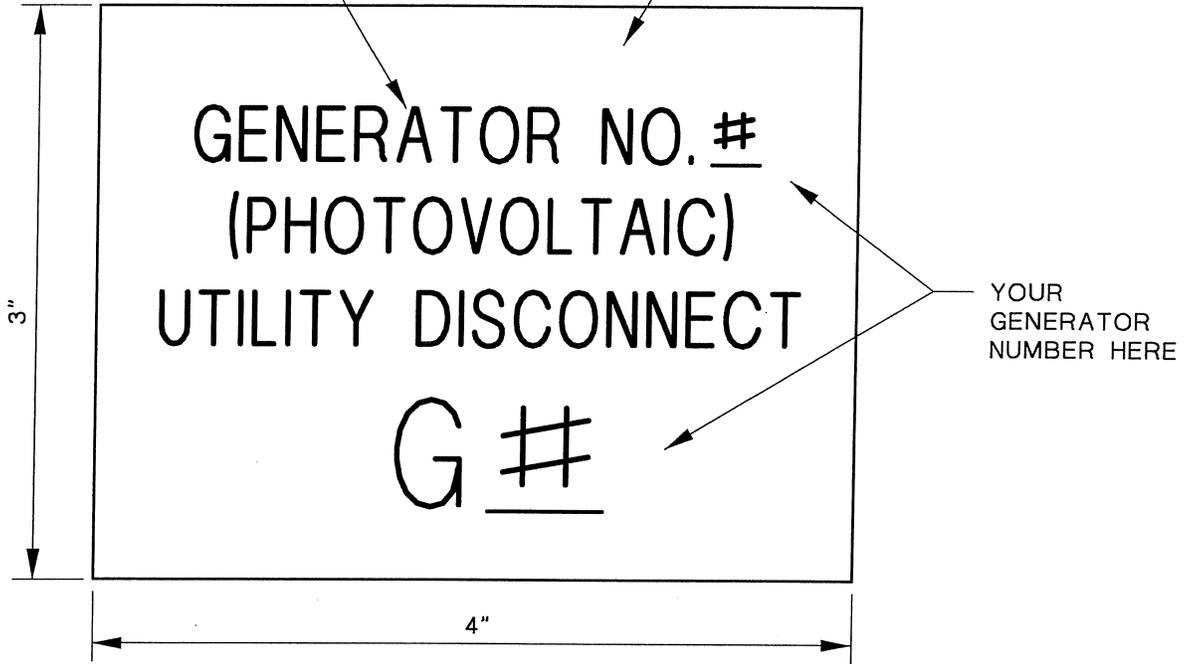

**GENERATOR DISCONNECT NAMEPLATE**

**NOTES:**

- 1) Nameplate located at isolation disconnect. Disconnect will provide visual open that is lockable.
- 2) Nameplate and disconnect required for generators that can operate in parallel with the electric distribution system.
- 3) Nameplate material shall be Romark, Gravoply Ultra or REU approved equal, matte surface, 2-ply, UV stable, 1/16" thick.
- 4) Lettering shall be Roman-S, center-aligned, all capitals. Text lines shall be 0.3" high, G# shall 0.6" high.
- 5) Contact REU at 339-7200 to get your generator number.

UPDATE PHONE NUMBER NOTE #5

**SHEET 1 OF 1**

ELECTRIC CONSTRUCTION STANDARD

**REU**

Redding Electric Utility

**GENERATION DISCONNECT NAMEPLATE**

DES/REV BRR/TAM	DATE 10/30/00	ELECTRIC ENGINEERING MANAGER <i>Tessa Miller</i>	REVISED 08/18/16	DWG. NO. CS0722
--------------------	------------------	---	---------------------	--------------------

